



ASME A112.36.2-2022/ CSA B79.2:22

National Standard of Canada
American National Standard



Cleanouts

Click to view the full PDF of ASME A112.36.2 CSA B79.2 2022



Legal Notice for Harmonized Standard Jointly Developed by ASME and CSA Group

Intellectual property rights and ownership

As between American Society of Mechanical Engineers ("ASME") and Canadian Standards Association (Operating as "CSA Group") (collectively "ASME and CSA Group") and the users of this document (whether it be in printed or electronic form), ASME and CSA Group are the joint owners of all works contained herein that are protected by copyright, all trade-marks (except as otherwise noted to the contrary), and all inventions and trade secrets that may be contained in this document, whether or not such inventions and trade secrets are protected by patents and applications for patents. The unauthorized use, modification, copying, or disclosure of this document may violate laws that protect the intellectual property of ASME and CSA Group and may give rise to a right in ASME and CSA Group to seek legal redress for such use, modification, copying, or disclosure. ASME and CSA Group reserve all intellectual property rights in this document.

Disclaimer and exclusion of liability

This document is provided without any representations, warranties, or conditions of any kind, express or implied, including, without limitation, implied warranties or conditions concerning this document's fitness for a particular purpose or use, its merchantability, or its non-infringement of any third party's intellectual property rights. ASME and CSA Group do not warrant the accuracy, completeness, or currency of any of the information published in this document. ASME and CSA Group make no representations or warranties regarding this document's compliance with any applicable statute, rule, or regulation.

IN NO EVENT SHALL ASME AND CSA GROUP, THEIR RESPECTIVE VOLUNTEERS, MEMBERS, SUBSIDIARIES, OR AFFILIATED COMPANIES, OR THEIR EMPLOYEES, DIRECTORS, OR OFFICERS, BE LIABLE FOR ANY DIRECT, INDIRECT, OR INCIDENTAL DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES, HOWSOEVER CAUSED, INCLUDING BUT NOT LIMITED TO SPECIAL OR CONSEQUENTIAL DAMAGES, LOST REVENUE, BUSINESS INTERRUPTION, LOST OR DAMAGED DATA, OR ANY OTHER COMMERCIAL OR ECONOMIC LOSS, WHETHER BASED IN CONTRACT, TORT (INCLUDING NEGLIGENCE), OR ANY OTHER THEORY OF LIABILITY, ARISING OUT OF OR RESULTING FROM ACCESS TO OR POSSESSION OR USE OF THIS DOCUMENT, EVEN IF ASME OR CSA GROUP HAVE BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES.

In publishing and making this document available, ASME and CSA Group are not undertaking to render professional or other services for or on behalf of any person or entity or to perform any duty owed by any person or entity to another person or entity. The information in this document is directed to those who have the appropriate degree of experience to use and apply its contents, and ASME and CSA Group accept no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained in this document.

ASME and CSA Group have no power, nor do they undertake, to enforce compliance with the contents of the standards or other documents they jointly publish.

Authorized use of this document

This document is being provided by ASME and CSA Group for informational and non-commercial use only. The user of this document is authorized to do only the following:

If this document is in electronic form:

- load this document onto a computer for the sole purpose of reviewing it;
- search and browse this document; and
- print this document if it is in PDF format.

Limited copies of this document in print or paper form may be distributed only to persons who are authorized by ASME and CSA Group to have such copies, and only if this Legal Notice appears on each such copy.

In addition, users may not and may not permit others to

- alter this document in any way or remove this Legal Notice from the attached standard;
- sell this document without authorization from ASME and CSA Group; or
- make an electronic copy of this document.

If you do not agree with any of the terms and conditions contained in this Legal Notice, you may not load or use this document or make any copies of the contents hereof, and if you do make such copies, you are required to destroy them immediately. Use of this document constitutes your acceptance of the terms and conditions of this Legal Notice.



ASME A112.36.2-2022/CSA B79.2:22
July 2022

To register for e-mail notification about any updates to this publication

- The **List ID** that you will need to register for updates to this publication is **2429837**.

If you require assistance, please e-mail techsupport@csagroup.org or call 416-747-2233.

ASME A112.36.2-2022/CSA B79.2:22

July 2022

Title: *Cleanouts*

To register for e-mail notification about any updates to this publication

- go to www.csagroup.org/store/
- click on **Product Updates**

The **List ID** that you will need to register for updates to this publication is **2429837**.

If you require assistance, please e-mail techsupport@csagroup.org or call 416-747-2233.

Visit CSA Group's policy on privacy at www.csagroup.org/legal to find out how we protect your personal information.

Canadian Standards Association (operating as “CSA Group”), under whose auspices this National Standard has been produced, was chartered in 1919 and accredited by the Standards Council of Canada to the National Standards system in 1973. It is a not-for-profit, nonstatutory, voluntary membership association engaged in standards development and certification activities.

CSA Group standards reflect a national consensus of producers and users — including manufacturers, consumers, retailers, unions and professional organizations, and governmental agencies. The standards are used widely by industry and commerce and often adopted by municipal, provincial, and federal governments in their regulations, particularly in the fields of health, safety, building and construction, and the environment.

More than 10 000 members indicate their support for CSA Group’s standards development by volunteering their time and skills to Committee work.

CSA Group offers certification and testing services in support of and as an extension to its standards development activities. To ensure the integrity of its certification process, CSA Group regularly and continually audits and inspects products that bear the CSA Group Mark.

In addition to its head office and laboratory complex in Toronto, CSA Group has regional branch offices in major centres across Canada and inspection and testing agencies in fourteen countries. Since 1919, CSA Group has developed the necessary expertise to meet its corporate mission: CSA Group is an independent service organization whose mission is to provide an open and effective forum for activities facilitating the exchange of goods and services through the use of standards, certification and related services to meet national and international needs.

For further information on CSA Group services, write to
CSA Group
178 Rexdale Boulevard
Toronto, Ontario, M9W 1R3
Canada

A National Standard of Canada is a standard developed by a Standards Council of Canada (SCC) accredited Standards Development Organization, in compliance with requirements and guidance set out by SCC. More information on National Standards of Canada can be found at www.scc.ca.

SCC is a Crown corporation within the portfolio of Innovation, Science and Economic Development (ISED) Canada. With the goal of enhancing Canada’s economic competitiveness and social well-being, SCC leads and facilitates the development and use of national and international standards. SCC also coordinates Canadian participation in standards development, and identifies strategies to advance Canadian standardization efforts.

Accreditation services are provided by SCC to various customers, including product certifiers, testing laboratories, and standards development organizations. A list of SCC programs and accredited bodies is publicly available at www.scc.ca.

Standards Council of Canada
600-55 Metcalfe Street
Ottawa, Ontario, K1P 6L5
Canada



Cette Norme Nationale du Canada n’est disponible qu’en anglais.

Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users to judge its suitability for their particular purpose.

**A trademark of the Canadian Standards Association, operating as “CSA Group”*

CSA Group

The Canadian Standards Association (operating as "CSA Group"), under whose auspices this National Standard has been produced, was chartered in 1919 and accredited by the Standards Council of Canada to the National Standards system in 1973. It is a not-for-profit, nonstatutory, voluntary membership association engaged in standards development and certification activities.

CSA Group standards reflect a national consensus of producers and users including manufacturers, consumers, retailers, unions and professional organizations, and governmental agencies. The standards are used widely by industry and commerce and often adopted by municipal, provincial, and federal governments in their regulations, particularly in the fields of health, safety, building and construction, and the environment. More than 10 000 members indicate their support for CSA Group's standards development by volunteering their time and skills to Committee work.

CSA Group offers certification and testing services in support of and as an extension to its standards development activities. To ensure the integrity of its certification process, CSA Group regularly and continually audits and inspects products that bear the CSA Group Mark.

In addition to its head office and laboratory complex in Toronto, CSA Group has regional branch offices in major centres across Canada and inspection and testing agencies in fourteen countries. Since 1919, CSA Group has developed the necessary expertise to meet its corporate mission: CSA Group is an independent service organization whose mission is to provide an open and effective forum for activities facilitating the exchange of goods and services through the use of standards, certification and related services to meet national and international needs.

For further information on CSA Group services, write to
CSA Group
178 Rexdale Boulevard, Toronto, Ontario,
Canada M9W 1R3

American National Standards Institute

The American National Standards Institute (ANSI), Inc. is the nationally recognized coordinator of voluntary standards development in the United States through which voluntary organizations, representing virtually every technical discipline and every facet of trade and commerce, organized labor and consumer interests, establish and improve the some 10 000 national consensus standards currently approved as American National Standards.

ANSI provides that the interests of the public may have appropriate participation and representation in standardization activity, and cooperates with departments and agencies of U.S. Federal, state and local governments in achieving compatibility between government codes and standards and the voluntary standards of industry and commerce.

ANSI represents the interests of the United States in international nontreaty organizations such as the International Organization for Standardization (ISO) and the International Electrotechnical Commission (IEC). The Institute maintains close ties with regional organizations such as the Pacific Area Standards Congress (PASC) and the Pan American Standards Commission (COPANT). As such, ANSI coordinates the activities involved in the U.S. participation in these groups.

ANSI approval of standards is intended to verify that the principles of openness and due process have been followed in the approval procedure and that a consensus of those directly and materially affected by the standards has been achieved. ANSI coordination is intended to assist the voluntary system to ensure that national standards needs are identified and met with a set of standards that are without conflict or unnecessary duplication in their requirements.

Responsibility of approving American standards rests with the
American National Standards Institute, Inc.
25 West 43rd Street, Fourth floor
New York, NY 10036

ASME/CSA Standard

ASME A112.36.2-2022/CSA B79.2:22 Cleanouts



®A trademark of the Canadian Standards Association and CSA America Inc., operating as "CSA Group"

*Published in July 2022 by CSA Group
A not-for-profit private sector organization
178 Rexdale Boulevard, Toronto, Ontario, Canada M9W 1R3
1-800-463-6727 • 416-747-4044*

Visit the CSA Group Online Store at www.csagroup.org/store/

*The American Society of Mechanical Engineers (ASME)
Two Park Avenue
New York, NY 10016-5990, USA
1-800-843-2763*

Visit the ASME Online Store at www.asme.org

Commitment for Amendments

This Standard is issued jointly by the American Society of Mechanical Engineers (ASME) and the Canadian Standards Association (Operating as “CSA Group”). Amendments to this Standard will be made only after processing according to the Standards writing procedures of both ASME and CSA Group.

The American Society of Mechanical Engineers (ASME)
Two Park Avenue
New York, NY 10016-5990
USA
1-800-843-2763
Visit the ASME Online Store at
www.asme.org

ISBN 978-0-7918-7516-2
Copyright © 2022 by The American Society of Mechanical Engineers (ASME)

This Standard is available for public review on a continuous basis. This provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public at large.

Published in July 2022 by
CSA Group
A not-for-profit private sector organization
178 Rexdale Boulevard
Toronto, Ontario, Canada
M9W 1R3
1-800-463-6727 or 416-747-4044
Visit the CSA Group Online Store at
www.csagroup.org/store/

ISBN 978-1-4883-4095-6
ICS 91.140.80
© 2022 Canadian Standards Association

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

Contents

ASME A112 Standards Committee on Plumbing Materials and Equipment 3

ASME A112.36.2 Project Team on Cleanouts 7

CSA Technical Committee on Drains and Interceptors 8

ASME/CSA Harmonization Task Group on Cleanouts 12

Preface 14

1 Scope 16

- 1.1 Inclusions 16
- 1.2 Illustrations 16
- 1.3 Terminology 16
- 1.4 Units of measure 16
- 1.5 Alternatives 16

2 Reference publications 16

3 Definitions and abbreviations 19

- 3.1 Definitions 19
- 3.2 Abbreviations 20

4 Materials 20

- 4.1 General 20
- 4.2 Metals 20
 - 4.2.1 Aluminum 20
 - 4.2.2 Bronze 20
 - 4.2.3 Cast iron 21
 - 4.2.4 Ductile iron 21
 - 4.2.5 Nickel-bronze 21
 - 4.2.6 Stainless steel 21
- 4.3 Polymeric compounds 21
 - 4.3.1 Acrylonitrile-butadiene-styrene (ABS) 21
 - 4.3.2 Polyethylene (PE) 21
 - 4.3.3 Polypropylene (PP) 21
 - 4.3.4 Polyvinylchloride (PVC) 21
 - 4.3.5 Polyvinylidene fluoride (PVDF) 21
- 4.4 Fastener materials 21
 - 4.4.1 Steel fasteners 21
 - 4.4.2 Removable fasteners 22
- 4.5 Finishes 22
 - 4.5.1 General 22
 - 4.5.2 Non-organic finishes 22
 - 4.5.3 Organic finishes 22

5 Design requirements 23

5.1	Outlet connections	23
5.1.1	General	23
5.1.2	Threaded outlet connections	23
5.1.3	Inside caulk outlet connections	23
5.1.4	Hub (push-on) outlet connections	23
5.1.5	Spigot (no hub or mechanical joint) outlet connections	23
5.1.6	Solvent-cemented outlet connections	23
5.1.7	O-ring, gasketed, and rubber coupling outlet connections	23
5.1.8	Butt welded outlet connections	23
5.2	Closure types	23
5.2.1	Minimum size requirements	23
5.2.2	Straight thread gasket closure	23
5.2.3	Tapered thread closure	24
5.2.4	Alternate closure types	24
5.3	Threaded fasteners	24
5.4	Cleanout covers	24
5.4.1	General	24
5.4.2	Leakage test	24
6	Test methods and performance requirements	24
6.1	Load testing for floor cleanout covers	24
6.1.1	Load classifications	24
6.1.2	Load failure	25
6.1.3	Test specimen material classification	25
6.1.4	Test platen	25
6.1.5	Test procedure	25
6.1.6	Safe live load	25
6.2	Sealing test for alternate closures and water-tight cleanout covers	25
6.2.1	Test method	25
6.2.2	Pass/fail criteria	26
7	Markings	26
7.1	Cleanouts	26
7.1.1	Permanent mark	26
7.1.2	Mark location	26
7.2	Elastomeric components	26
7.3	Permanent markings	26

ASME A112 Standards Committee on Plumbing Materials and Equipment

W. M. Smith	American Society of Plumbing Engineers, Montgomery, Alabama, USA	<i>Chair</i>
S. Rawalpindiwala	Kohler Co., Kohler, Wisconsin, USA	<i>Vice-Chair</i>
M. R. Gibeault	Kohler Co., Kohler, Wisconsin, USA	<i>Alternate</i>
A. L. Guzman Rodriguez	American Society of Mechanical Engineers, New York, New York, USA	<i>Staff Secretary</i>
R. K. Adler	City of San Jose, San Jose, California, USA	
J. A. Ballanco	JB Engineering & Code Consulting, PC, Munster, Indiana, USA	
J. E. Bertrand	Watts Water Technologies, Inc., Avon, Ohio, USA	
C. Haldiman	Watts Regulator, North Andover, Massachusetts, USA	<i>Alternate</i>
T. Burger	ASSE International, Mokena, Illinois, USA	
R. Burnham	Zurn Industries LLC, Erie, Pennsylvania, USA	
M. Campos	ICC Evaluation Service, LLC, Brea, California, USA	
S. L. Cavanaugh	Cavanaugh Consulting, Santa Fe, New Mexico, USA	<i>Contributing Member</i>
W. E. Chapin	Professional Code Consulting, LLC, Cullman, Alabama, USA	

P. V. DeMarco	IAPMO, Dayton, New Jersey, USA	
N. E. Dickey	Hansgrohe, Inc., Alpharetta, Georgia, USA	
G. S. Duren	Code Compliance, Inc., S Pasadena, Florida, USA	
R. Emmerson	Consultant, Arlington Heights, Illinois, USA	
K. Ernst	OS&B, Oakville, Ontario, Canada	
R. L. George	Plumb-Tech Design and Consulting Services L.L.C., Newport, Michigan, USA	
D. Gleiberman	Sloan Valve Co., Los Angeles, California, USA	
J. W. Lauer	Sloan Valve Company, Anaheim, California, USA	<i>Alternate</i>
M. Guard	Regulosity, LLC, Wauwatosa, Wisconsin, USA	
G. W. Harrison	Wayne Harrison Consulting, Edmond, Oklahoma, USA	
L. Himmelblau	Chicago Faucet, Des Plaines, Illinois, USA	
J. Kendzel	American Supply Association, Itasca, Illinois, USA	<i>Contributing Member</i>
J. M. Koeller	Koeller and Co., Yorba Linda, California, USA	
N. M. Kummerlen	Consultant, Lorain, Ohio, USA	<i>Contributing Member</i>

C. J. Lagan	American Standard/LIXIL, Piscataway, New Jersey, USA	
M. Malatesta	American Standard/LIXIL, Piscataway, New Jersey, USA	<i>Alternate</i>
W. H. LeVan	Cast Iron Soil Pipe Institute, Auburn, Alabama, USA	
D. Parney	Cast Iron Soil Pipe Institute, Mundelein, Illinois, USA	<i>Alternate</i>
D. Marbry	Fluidmaster, Inc., San Juan Capistrano, California, USA	
R. Mata	American Society of Plumbing Engineers, Mentor, Ohio, USA	
D. Liang	CSA Group, Toronto, Ontario, Canada	<i>Contributing Member</i>
L. A. Mercer	IAPMO Group, Valley City, Ohio, USA	
J. Menard	CSA Group, Toronto, Ontario, Canada	<i>Contributing Member</i>
A. Murra	Abraham Murra Consulting, Rancho Santa Margarita, California, USA	
D. Orton	NSF International, Ann Arbor, Michigan, USA	
A. Ciechanowski	NSF International, Ann Arbor, Michigan, USA	<i>Alternate</i>
R. Pickering	Eastern Research Group, Inc., Morrisville, North Carolina, USA	<i>Contributing Member</i>
A. Poon	Delta Faucet Company, Indianapolis, Indiana, USA	

B. Ramkarran	Infinity Drains, LTD., Amityville, New York, USA	<i>Contributing Member</i>
S. A. Remedios	Remedios Consulting LLC, London, Ontario, Canada	
M. Sigler	International Code Council, Orlando, Florida, USA	
G. L. Simmons	Charlotte Pipe & Foundry, Charlotte, North Carolina, USA	
W. B. Morris	Charlotte Pipe & Foundry, Charlotte, North Carolina, USA	<i>Alternate</i>
S. Tanner	US Environmental Protection Agency, Washington, District of Columbia, USA	<i>Contributing Member</i>
J. C. Watson	Elkay Manufacturing, Downers Grove, Illinois, USA	
M. Weiss	Plumbing and Drainage Institute, Polson, Montana, USA	
W. C. Whitehead	Whitehead Consulting Services, Red Oak, Texas, USA	
S. J. McDanal	Jay R. Smith Mfg. Co., Montgomery, Alabama, USA	<i>Alternate</i>

ASME A112.36.2 Project Team on Cleanouts

N. E. Dickey	Hansgrohe, Inc, Alpharetta, Georgia, USA	<i>Chair</i>
R. Burnham	Zurn Industries LLC, Erie, Pennsylvania, USA	
M. Campos	ICC Evaluation Service, LLC, Brea, California, USA	
K. Ernst	OS&B, Oakville, Ontario, Canada	
R. L. George	Plumb-Tech Design and Consulting Services L.L.C, Newport, Michigan, USA	
D. Orton	NSF International, Ann Arbor, Michigan, USA	
B. Tubaugh	Josam Company, Michigan City, Indiana, USA	
M. Weiss	Plumbing & Drainage Institute (PDI), Polson, Montana, USA	

CSA Technical Committee on Drains and Interceptors

R. Beaulieu	Canplas Industries Ltd, Barrie, Ontario, Canada <i>Category: Producer Interest</i>	<i>Chair</i>
B. Brown	Schier Products, Edwardsville, Kansas, USA	<i>Non-voting</i>
T. Burger	ASSE International, Cleveland, Ohio, USA	<i>Non-voting</i>
R. Burnham	Zurn Industries LLC, Erie, Pennsylvania, USA <i>Category: Producer Interest</i>	
M. Constantin	City of Edmonton, Edmonton, Alberta, Canada <i>Category: Regulatory Authority</i>	
J. Costa	Good Harbour Labs, Mississauga, Ontario, Canada	<i>Non-voting</i>
P. Despatis	Régie du bâtiment du Québec, Montréal, Québec, Canada <i>Category: Regulatory Authority</i>	
N. Dickey	Hansgrohe, Inc, Alpharetta, Georgia, USA <i>Category: Producer Interest</i>	
G. Emberson	Contour Industries Inc., Toronto, Ontario, Canada	<i>Non-voting</i>
R. Fenney	Fenney & Associates Inc, London, Ontario, Canada	<i>Non-voting</i>
S. Ferrazzo	Green Turtle - Zurn, Charlotte, North Carolina, USA	<i>Non-voting</i>

B. Ghaly	Watts Regulator Co., Burlington, Ontario, Canada <i>Category: Producer Interest</i>	
M. Gordon	Regional Municipality of Waterloo, Cambridge, Ontario, Canada <i>Category: Regulatory Authority</i>	
A. Guzman Rodriquez	American Society of Mechanical Engineers (ASME), New York, New York, USA	<i>Non-voting</i>
G. Hale	The Corporation of the Town of Markham, Markham, Ontario, Canada <i>Category: Regulatory Authority</i>	
G. W. Harrison	Wayne Harrison Consulting, Edmond, Oklahoma, USA <i>Category: User/General Interest</i>	
E. Ho	IAPMO Group, Markham, Ontario, Canada <i>Category: User/General Interest</i>	
K. S. Hui	Ontario Ministry of Municipal Affairs, Toronto, Ontario, Canada	<i>Non-voting</i>
D. Liang	CSA Group, Toronto, Ontario, Canada <i>Category: User/General Interest</i>	
K. Loucks	Schier Products Company, Vancouver, Washington, USA <i>Category: Producer Interest</i>	
R. Mata	American Society of Plumbing Engineers, Mentor, Ohio, USA	
A. Mikrogianakis	Goslyn Canada, Aurora, Ontario, Canada <i>Category: Producer Interest</i>	
A. Murra	Abraham Murra Consulting, Rancho Santa Margarita, California, USA	<i>Non-voting</i>

B. Orr	City of London, London, Ontario, Canada <i>Category: Regulatory Authority</i>	
D. Orton	NSF International, Ann Arbor, Michigan, USA <i>Category: User/General Interest</i>	
T. P. Palkon	IAPMO R&T, Mokena, Illinois, USA	<i>Non-voting</i>
H. Parlee	City of Edmonton, Edmonton, Alberta, Canada	<i>Non-voting</i>
F. Piazza	Richmond Hill, Ontario, Canada	<i>Non-voting</i>
A. Puddicomb	City of Toronto, Toronto Water, Toronto, Ontario, Canada <i>Category: Regulatory Authority</i>	
S. A. Remedios	Remedios Consulting, London, Ontario, Canada <i>Category: User/General Interest</i>	
D. Rockwell	Rockwell Supplies, Lower Sackville, Nova Scotia, Canada	<i>Non-voting</i>
W. Smith	American Society of Plumbing Engineers (ASPE), Montgomery, Alabama, USA	<i>Non-voting</i>
C. Spagnuolo	Region of Peel, Mississauga, Ontario, Canada <i>Category: Regulatory Authority</i>	
M. Weiss	PDI, Polson, Montana, USA <i>Category: User/General Interest</i>	
F. Winter	Canplas, Barrie, Ontario, Canada	<i>Non-voting</i>

M. KhalilCSA Group,
Toronto, Ontario, Canada*Project Manager***J. Menard**CSA Group,
Toronto, Ontario, Canada*Project Manager*

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.36.2 CSA B79.2 2022

ASME/CSA Harmonization Task Group on Cleanouts

N. E. Dickey	Hansgrohe Inc., Alpharetta, Georgia, USA	<i>Chair</i>
R. Beaulieu	Canplas Industries Ltd., Barrie, Ontario, Canada	
R. Burnham	Zurn Industries LLC, Erie, Pennsylvania, USA	
M. Campos	ICC Evaluation Service, LLC, Brea, California, USA	
K. Ernst	OS&B, Oakville, Ontario, Canada	
R. L. George	Plumb-Tech Design and Consulting Services L.L.C., Newport, Michigan, USA	
E. Ho	IAPMO Group, Markham, Ontario, Canada	
D. Liang	CSA Group, Toronto, Ontario, Canada	
D. Orton	NSF International, Ann Arbor, Michigan, USA	
R. Mata	American Society of Plumbing Engineers, Mentor, Ohio, USA	
S. A. Remedios	Remedios Consulting, London, Ontario, Canada	
C. Rylant	Jay R. Smith Mfg. Co., Montgomery, Alabama, USA	
D. Smith	Kusel Equipment Co., Watertown, Wisconsin, USA	

B. Tubaugh	Josam Company, Michigan City, Indiana, USA
K. Thompson	Plumbing Manufacturers International, McLean, Virginia, USA
M. Weiss	Plumbing & Drainage Institute (PDI), Polson, Montana, USA
T. C. Valente	CSA Group, Independence, Ohio, USA

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.36.2 CSA B79.2 2022

Preface

This is the first edition of ASME A112.36.2/CSA B79.2, *Cleanouts*. It supersedes CSA B79, *Commercial and residential drains and cleanouts*, published in 2008, and the ASME A112.36.2M-1991(2012) *Cleanouts Standards*.

This Standard was prepared by the ASME/CSA Harmonization Task Group on Cleanouts under the jurisdiction of the ASME A112 Standards Committee on Plumbing Materials and Equipment and the CSA Technical Committee on Drains and Interceptors. The ASME A112 Standards Committee operates under the jurisdiction of the ASME Board on Standardization and Testing and the CSA Technical Committee operates under the jurisdiction of the CSA Strategic Steering Committee on Construction and Civil Infrastructure.

This Standard is considered suitable for use for conformity assessment within the stated scope of the Standard.

This Standard was approved as an American National Standard by the American National Standards Institute on May 6, 2022.

This Standard has been developed in compliance with Standards Council of Canada requirements for National Standards of Canada. It has been published as a National Standard of Canada by CSA Group.

ASME Notes:

- 1) *The next edition of this standard is scheduled for publication in 2025.*
- 2) *This standard was developed under procedures accredited as meeting the criteria for American National Standards and it is an American National Standard. The standards committee that approved the code or standard was balanced to ensure that individuals from competent and concerned interests had an opportunity to participate. The proposed standard was made available for public review and comment, which provided an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.*
- 3) *ASME does not “approve,” “rate,” or “endorse” any item, construction, proprietary device, or activity. ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor does ASME assume any such liability. Users of a standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.*
- 4) *Participation by federal agency representatives or persons affiliated with industry is not to be interpreted as government or industry endorsement of this standard.*
- 5) *ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.*
- 6) *Upon request, ASME will issue an interpretation of any requirement of this standard. An interpretation can be issued only in response to a request submitted through the online Interpretation Submittal Form. The form is accessible at <http://go.asme.org/InterpretationRequest>. ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME committee.*

Interpretations are published on the ASME website under the Committee Pages at <http://cstools.asme.org/> as they are issued.

CSA Notes:

- 1) *Use of the singular does not exclude the plural (and vice versa) when the sense allows.*
- 2) *Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.*
- 3) *This publication was developed by consensus, which is defined by CSA Policy governing standardization — Code of good practice for standardization as “substantial agreement. Consensus implies much more than a simple majority, but not necessarily unanimity”. It is consistent with this definition that a member may be included in the Technical Committee list and yet not be in full agreement with all clauses of this publication.*
- 4) *This Standard is subject to review within five years from the date of publication. Suggestions for its improvement will be referred to the appropriate committee.*
- 5) *To submit a request for interpretation of this Standard, please send the following information to inquiries@csagroup.org and include “Request for interpretation” in the subject line:*
 - a) *define the problem, making reference to the specific clause, and, where appropriate, include an illustrative sketch;*
 - b) *provide an explanation of circumstances surrounding the actual field condition; and*
 - c) *where possible, phrase the request in such a way that a specific “yes” or “no” answer will address the issue.*

Committee interpretations are processed in accordance with the CSA Directives and guidelines governing standardization and are available on the Current Standards Activities page at standardsactivities.csa.ca.

- 6) *Attention is drawn to the possibility that some of the elements of this Standard may be the subject of patent rights. CSA Group is not to be held responsible for identifying any or all such patent rights. Users of this Standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.*

ASME A112.36.2-2022/CSA B79.2:22

Cleanouts

1 Scope

1.1 Inclusions

This Standard covers cleanouts, including floor and wall types, used in concealed piping in and adjacent to residential, commercial, industrial, institutional, and other buildings open to the public.

1.2 Illustrations

Figure 1 included in this Standard is intended only to describe and portray typical floor and wall type cleanouts and is not intended to restrict design or to specify requirements.

1.3 Terminology

In this Standard, “shall” is used to express a requirement, i.e., a provision that the user is obliged to satisfy in order to comply with the standard; “should” is used to express a recommendation or that which is advised but not required; and “may” is used to express an option or that which is permissible within the limits of the Standard.

Notes accompanying clauses do not include requirements or alternative requirements; the purpose of a note accompanying a clause is to separate from the text explanatory or informative material.

Notes to tables and figures are considered part of the table or figure and may be written as requirements.

Annexes are designated normative (mandatory) or informative (non-mandatory) to define their application.

1.4 Units of measure

The values given in either SI (metric) or U.S. Customary units of measure are equivalent in application; however, each measurement system is to be used independently of the other. In this Standard, U.S. Customary units are shown in parentheses. Combining values from the two measurement systems can result in non-conformance with this Standard.

1.5 Alternatives

The requirements of this Standard are not intended to prevent the use of alternative designs, materials, or methods of construction, provided such alternatives meet the intent and requirements of the Standard.

2 Reference publications

This Standard refers to the following publications, and where such reference is made, it shall be to the edition listed below, including all amendments published thereto.

ASME (The American Society of Mechanical Engineers)

A112.3.1-2007(R2017)

Stainless steel drainage systems for sanitary DWV, storm, and vacuum applications, above- and below-ground

B1.20.1-2013 (R2018)

Pipe threads, general purpose, Inch

B16.25-2017

*Buttwelding ends***ASME (The American Society of Mechanical Engineers)/CSA Group**

ASME A112.18.1-2018/CSA B125.1-18

*Plumbing fixture fittings***CSA Group**

B602:20

Mechanical couplings for drain, waste, and vent pipe and sewer pipe

C22.2 No. 0.15:15 (R2020)

*Adhesive labels***ASTM International (American Society for Testing and Materials)**

A48/A48M-03 (2016)

Standard specification for gray iron castings

A53/A53M-20

Standard specification for pipe, steel, black and hot-dipped, zinc-coated, welded and seamless

A74-20

Standard specification for cast iron soil pipe and fittings

A123/A123M-17

Standard specification for zinc (hot-dip galvanized) coatings on iron and steel products

A153/A153M-16a

Standard specification for zinc coating (hot-dip) on iron and steel hardware

A307-14e1

Standard specification for carbon steel bolts, studs, and threaded rod 60 000 PSI tensile strength

A312/A312M-19

Standard specification for seamless, welded, and heavily cold worked austenitic stainless steel pipes

A536-84(2019)e1

Standard specification for ductile iron casings

A563-15

Standard specification for carbon and alloy steel nuts

A888-20

Standard specification for hubless cast iron soil pipe and fittings for sanitary and storm drain, waste, and vent piping applications

B26/B26M-18e1

Standard specification for aluminum-alloy sand castings

B85/B85M-18e1

standard specification for aluminum- alloy die castings

B117-19

Standard practice for operating salt spray (fog) apparatus

B209/B209M-14

Standard specification for aluminum and aluminum-alloy sheet and plate

B221-20

Standard specification for aluminum and aluminum-alloy extruded bars, rods, wire, profiles, and tubes

B584-14

Standard specification for copper alloy sand castings for general applications

B633-19

Standard specification for electrodeposited coatings of zinc on iron and steel

B766-86 (2015)

Standard specification for electrodeposited coatings of cadmium

C564-20a

Standard specification for rubber gaskets for cast iron soil pipe and fittings

C1440-17

Standard specification for thermoplastic elastomeric (TPE) gasket materials for drain, waste, and vent (DWV), sewer, sanitary, and storm plumbing systems

D395-18

Standard Test Methods for Rubber Property — Compression Set

D412-16 (2021)

Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers — Tension

D471-16a (2021)

Standard Test Method for Rubber Property — Effect of Liquids

D573-04 (2019)

Standard Test Method for Rubber — Deterioration in an Air Oven

D624-00 (2020)

Standard Test Method for Tear Strength of Conventional Vulcanized Rubber and Thermoplastic Elastomers

D1149-18

Standard Test Methods for Rubber Deterioration — Cracking in an Ozone Controlled Environment

D1784-20

Standard classification system and basis for specification for rigid poly(vinyl chloride) (PVC) compounds and chlorinated poly (vinyl chloride) (CPVC) compounds

D2661-14e1

Standard specification for acrylonitrile-butadiene-styrene (ABS) schedule 40 plastic drain, waste, and vent pipe and fittings

D2665-20

Standard specification for poly(vinyl chloride) (PVC) plastic drain, waste, and vent pipe and fittings

D3222-20

Standard specification for unmodified poly(vinylidene fluoride) (PVDF) molding extrusion and coating materials

D3350-14

Standard specification for polyethylene plastics pipe and fittings materials

D3965-16

Standard classification system and basis for specifications for rigid acrylonitrile-butadiene-styrene (ABS) materials for pipe and fittings

D4101-17e1

Standard classification system and basis for specification for polypropylene injection and extrusion materials

D5575-18

Standard classification system for copolymers of vinylidene fluoride (VDF) with other fluorinated monomers

CISPI (Cast Iron Soil Pipe Institute)

301-18

Standard specification for hubless cast iron soil pipe and fittings for sanitary and storm drain, waste, and vent piping applications

UL (Underwriters Laboratories)

969, edition 5

Standard for marking and labelling systems

3 Definitions and abbreviations

3.1 Definitions

The following definitions shall apply in this Standard:

Blowhole — a hole in a casting caused by air or gas in the metal or mold.

Cleanout — a fitting that permits access to a drainage system.

Closure — a plug or sealing component to prevent the release of sewer gas and water.

Cold shut — a casting defect formed when two streams of metal become so cold that they do not fuse upon meeting, creating an incomplete casting.

Cover — an optional cosmetic or mechanical appurtenance to provide access to a cleanout closure.

Standard plumbing tools — tools that are normally utilized by plumbers for installing and maintaining plumbing equipment.

Note: *Standard plumbing tools include screwdrivers, key wrenches, flat-jawed wrenches, and pliers.*

Top rim — the part of a cleanout that structurally supports the cover.

3.2 Abbreviations

The following abbreviations shall apply in this Standard:

ABS	— acrylonitrile-butadiene-styrene
DWV	— drain, waste, and vent
ID	— inside diameter
NPSL	— National Pipe Straight Locknut
NPSM	— National Pipe Straight Mechanical
NPT	— National Pipe Tapered
OD	— outside diameter
PE	— polyethylene
PP	— polypropylene
PVC	— polyvinylchloride
PVDF	— polyvinylidene fluoride

4 Materials

4.1 General

Cleanouts shall be made of materials suitable for the intended service. Castings shall be sound and free of blowholes, cold shuts, fins, and other imperfections, and true to pattern.

4.2 Metals

4.2.1 Aluminum

Aluminum sand castings shall comply with ASTM B26. Aluminum die castings shall comply with ASTM B85. Aluminum sheet and plate shall comply with ASTM B209. Aluminum extruded bars, rods, wire, profiles, and tubes shall comply with ASTM B221.

4.2.2 Bronze

Bronze castings shall comply with the requirements of copper alloy UNS No. C83450, No. C83600, No. C83800, or No. C84400, as specified in ASTM B584.

4.2.3 Cast iron

Cast iron shall comply with the requirements of Class 25, as specified in ASTM A48/A48M.

4.2.4 Ductile iron

Ductile iron shall comply with the requirements of Grade 60-40-18, Grade 60-42-10, Grade 60-45-12, or Grade 80-55-06, as specified in ASTM A536.

4.2.5 Nickel-bronze

Nickel-bronze shall comply with the requirements of ASTM B584. The copper alloy shall be UNS No. C97300, No. C97600, No. C99700, or an alloy with a minimum content as follows:

Element	Minimum content, %
Copper	60
Zinc	16
Nickel	12
Lead	5
Tin	3

4.2.6 Stainless steel

Stainless steel alloys shall be of the 300 or 400 series.

4.3 Polymeric compounds

4.3.1 Acrylonitrile-butadiene-styrene (ABS)

ABS shall meet or exceed the requirements of cell classification 32222, as specified in ASTM D3965.

4.3.2 Polyethylene (PE)

PE shall comply with the requirements of ASTM D3350.

4.3.3 Polypropylene (PP)

PP shall comply with the requirements of ASTM D4101.

4.3.4 Polyvinylchloride (PVC)

PVC shall meet or exceed the requirements of cell classification 12454 or 14333, as specified in ASTM D1784.

4.3.5 Polyvinylidene fluoride (PVDF)

PVDF shall comply with the requirements of ASTM D3222 or ASTM D5575.

4.4 Fastener materials

4.4.1 Steel fasteners

Materials used for studs, nuts, bolts, cap screws, and other steel fasteners shall comply with or exceed the mechanical requirements of Grade A steel, as specified in ASTM A307 or ASTM A563.

4.4.2 Removable fasteners

Removable fasteners for covers shall be made of corrosion-resistant material or coated in accordance with Clause [4.5](#).

4.5 Finishes

4.5.1 General

Coated or plated components shall be prepared in such a way that a suitable surface for proper bonding of the finish is provided. Coated areas visible after installation shall be free of defects and uncoated areas shall not be stained.

4.5.2 Non-organic finishes

4.5.2.1 Preparation

Parts to be coated with non-organic finishes shall be prepared as specified in Items a) to e), as appropriate:

- a) Parts to be cadmium-plated shall be prepared and plated in accordance with ASTM B766.
- b) Parts to be chrome-plated shall be polished before plating and subsequently given a commercial grade copper-nickel-chromium plate.
- c) Parts to be given a commercial grade bronze chromate treatment shall first be given a commercial grade cadmium plate treatment.
- d) Parts to be zinc plated shall be prepared in accordance with ASTM B633.
- e) Parts to be hot-dip galvanized shall be coated in accordance with ASTM A153/A153M or ASTM A123/A123M.

4.5.2.2 Corrosion-resistance test for non-organic finishes

4.5.2.2.1 Test specimen

Test specimens shall be received from the manufacturer and shall not have been subjected to any other test.

4.5.2.2.2 Test procedure

Coated parts shall be tested in accordance with ASTM B117 for 24 h. Coated and uncoated parts may be polished or cleaned with a common household or metal cleaner before evaluation.

4.5.2.2.3 Pass/fail criteria

Upon completion of the testing specified in Clause [4.5.2.2.2](#),

- a) coatings shall not show more than one surface defect in any 650 mm² (1.0 in²) area that is visible after installation, or up to three surface defects on a 25 mm (1.0 in) length of parting line;
- b) surface defects shall not be larger than 0.8 mm (0.03 in) in any dimension; and
- c) if widely scattered surface defects are observed after testing (as occasionally occurs), such defects shall not significantly deface or adversely affect the function of the coated part.

4.5.3 Organic finishes

Organic finishes shall comply with the applicable coatings requirements of ASME A112.18.1/CSA B125.1.

5 Design requirements

5.1 Outlet connections

5.1.1 General

The outlets identified in Clause [5.1](#) shall have one of the connections specified in Clauses [5.2.2](#) to [5.2.4](#).

5.1.2 Threaded outlet connections

Threaded outlet connections shall be American National Standard Taper Pipe Threads for general use (NPT), as specified in ASME B1.20.1, and female connections shall have the minimum dimensions specified in Table [1](#).

5.1.3 Inside caulk outlet connections

Inside caulk outlet connections shall have the dimensions specified in Table [2](#).

5.1.4 Hub (push-on) outlet connections

Hub (push-on) outlet connections shall have the dimensions specified in Table [3](#).

5.1.5 Spigot (no hub or mechanical joint) outlet connections

Outlet end of spigot (no hub or mechanical joint) connections shall comply with the outside diameter and minimum wall thickness specified in ASTM A53, ASTM A74, ASTM A312/312M, ASTM A888, ASTM D2661, ASTM D2665, or CISPI 301.

5.1.6 Solvent-cemented outlet connections

Solvent-cemented outlet connections shall comply with the requirements of ASTM D2661 for ABS joints or ASTM D2665 for PVC joints.

5.1.7 O-ring, gasketed, and rubber coupling outlet connections

O-ring or gasketed outlet connections and rubber couplings for gasketed outlet connections shall comply with the applicable requirements of ASME A112.3.1, ASTM C564, ASTM C1440, or CSA B602.

5.1.8 Butt welded outlet connections

Outlet connections intended for butt welding shall comply with the requirements of ASME B16.25.

5.2 Closure types

5.2.1 Minimum size requirements

The minimum size requirements shall be as specified in Table [4](#).

5.2.2 Straight thread gasket closure

Figure [2](#) shows a tapered shoulder gasket seal type plug with NPSL or NPSM threads, either raised or countersunk, with provision for a cover either raised or countersunk, with provision for a cover securing screw, where required. The gasket shall be lead or elastomer material in order to provide a gas tight seal.

5.2.3 Tapered thread closure

Figure 3 shows a plug with NPT threads. It may be either raised head or countersunk with provision for a cover securing screw, where required. The seal is formed by the makeup of threads.

5.2.4 Alternate closure types

Alternate closure types shall comply with the sealing test prescribed in Clause 6.2. Elastomeric components shall meet the following minimum requirements:

Test name	ASTM method	Minimum
Tensile	D412	6895 kPa (1000 psi)
Accelerated aging	D573	15% max tensile change, 20% max elongation change
Compression set	D395 method B	25% max after 22 h at 70 °C (158 °F)
Oil immersion	D471	80% max volume change tested at 40 °C (104 °F)
Ozone cracking	D1149	No cracks after 100 h at 1 ppm 38 °C (100 °F)
Tear strength	D624	Die C, 2.68 kg/mm (150 lb per inch) of thickness
Water absorption	D471	20% max by weight after 7 days at 70 °C (158 °F)

Note: An alternate closure type is a closure other than a straight thread gasket closure or a tapered thread closure.

5.3 Threaded fasteners

Threaded fasteners shall have standard commercial threads and shall be capable of being installed and removed by standard plumbing tools or manufacturer-provided tools.

5.4 Cleanout covers

5.4.1 General

Covers shall be removable without the use of special tools, unless provided by the manufacturer.

5.4.2 Leakage test

Cleanout covers intended to be water tight shall not leak when tested in accordance with Clause 6.2. Products with closure types complying with Clause 5.2.2 or 5.2.3 are exempt from this requirement.

6 Test methods and performance requirements

6.1 Load testing for floor cleanout covers

6.1.1 Load classifications

For loading test purposes, the cleanout cover, or top rim, shall be assigned one of the following load classifications, in accordance with the type of traffic that the cleanout cover, or top rim, will be subjected to under typical conditions of use:

Load classification	Safe live load (minimum design load), kg (lb)	Test load, kg (lb)
LD light duty	200 (441)	400 (882)
MD medium duty	900 (1984)	1800 (3968)
HD heavy duty	1650 (3638)	3300 (7276)
XHD extra heavy duty	3402 (7500)	6804 (15 000)
SD special duty	4536 (10 000)	9072 (20 000)

6.1.2 Load failure

The load at failure shall be

- for brittle materials (see Clause [6.1.3](#)), the load at which the first fracture on any part of the test specimen appears; and
- for ductile materials (see Clause [6.1.3](#)), the load at which the permanent set (at the point of loading) is greater than 2% of the longest transverse dimension of the specimen (see Figure [5](#)).

6.1.3 Test specimen material classification

Test specimens made of several materials shall be deemed made of brittle or ductile materials, depending upon the material of which its structural portion is made.

6.1.4 Test platen

The platen shall have a diameter of

- 90 mm (3.5 in), covers 114 mm (4.5 in) or larger in diameter, or in width for rectangular covers; or
- 50 mm (2 in), covers smaller than 114 mm (4.5 in).

6.1.5 Test procedure

The load test shall be conducted as follows:

- Mount the test specimen in accordance with the manufacturer's instructions.
- Using the platen specified in Clause [6.1.4](#), gradually apply a load at the centre of the specimen until the test load specified in Clause [6.1.1](#), or the load at failure, as specified in Clause [6.1.2](#), is reached, whichever is reached first (i.e., whichever load is smaller).

6.1.6 Safe live load

The safe live load shall be

- calculated by dividing by two the test load or the load at failure determined in Clause [6.1.5](#), whichever is smaller; and
- used to determine the load classification, in accordance with Clause [6.1.1](#).

6.2 Sealing test for alternate closures and water-tight cleanout covers

6.2.1 Test method

6.2.1.1 Assembly and pressurization

The cleanout cover and/or closures shall be assembled in accordance with the manufacturer's instructions. The assembly shall be pressurized with water head pressure of $3.048 \text{ m} \pm 51 \text{ mm}$ ($10 \text{ ft} \pm 2 \text{ in}$). The water head pressure shall be measured from the highest point of the sealing surface

as illustrated in Figure 4, and allowed to stand for 15 min. The assembly shall be checked for any sign of leakage. Alternative test apparatus that achieve the same pressure and tolerances are acceptable.

Note: Verify the air has been purged from test assembly before testing.

6.2.1.2 Disassembly and retesting

If there is no leakage, the pressure shall be released and the assembly stored at laboratory atmospheric conditions for at least 96 h. The cleanout cover and/or closures shall then be removed and, after 1 h, reassembled and retested in accordance with Clause [6.2.1.1](#).

6.2.2 Pass/fail criteria

The cleanout cover and/or closures shall not leak. Any leakage at the cleanout cover and/or closure joint shall be cause for rejection.

7 Markings

7.1 Cleanouts

7.1.1 Permanent mark

Cleanouts shall be permanently marked with the manufacturer's name or trademark or, in the case of private labelling, the name, trademark, or other mark of the customer for whom the cleanout was manufactured.

7.1.2 Mark location

The markings specified in Clause [7.1.1](#) shall appear on the cleanout cover or near the top rim (as applicable) of the cleanout body.


7.2 Elastomeric components

Elastomeric components of push-on compression joints shall be permanently marked with the manufacturer's name or trademark.

7.3 Permanent markings

Acceptable means of applying permanent markings shall include, but not be limited to, firing on, etching, sand blasting, mechanical stamping, stamping with a permanent (non-water soluble) ink, and casting in. Adhesive labels that comply with CSA C22.2 No. 0.15 or UL 969 shall also be considered permanent when placed on a surface that is not normally submerged in water. The exposure conditions specified in Clause 7.1 of UL 969 shall apply.

Table 1
Threaded connections
 (See Clause 5.1.2.)

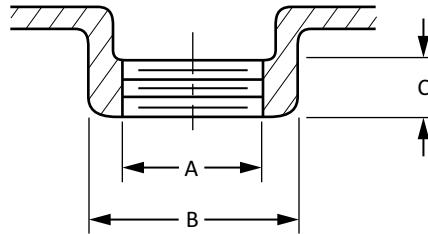

A, NPT connection size	B, minimum OD, mm (in)	C, minimum thread length, mm (in)
1-1/2	59 (2.31)	11 (0.43)
2	73 (2.87)	11 (0.43)
2-1/2	85 (3.34)	16 (0.62)
3	105 (4.12)	19 (0.75)
4	130 (5.12)	20 (0.78)
5	159 (6.25)	22 (0.87)
6	184 (7.25)	25 (1.00)
8	235 (9.25)	27 (1.06)